


Water Fountain Inventory						
Date:	1/15/2019					
Done By:	Laurel Klein					
Armory Name:	Atlantic City					
Armorer:	Jake Falana					


Site	Location	Room	Equipment Name	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (Ibs/oz)
	Armory	105	Water Fountain	HALSEY TAYLOR	HAC8FSCQ	111128227	R134A	Medium	3.85 OZ
Atlantic City	Armory	111	Water Fountain	Elkay	AMABF8 1B	111219100	R134A	Medium	3.65oz
	Armory	220	Water Fountain	ELKAY	EBFSA8 1D	99103604	R134A	Medium	4 OZ
	Armory	201	Water Fountain	Drink	Foundation01	123456	R402A	High	2.34


Color Code Index							
	Totals						
Class 1	0						
Class 2	1						
Missing Code	0						
GWP Level	I* Index						
High	Greater than 2500						
Medium	150-2500						
Low	Less than 150						
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.							

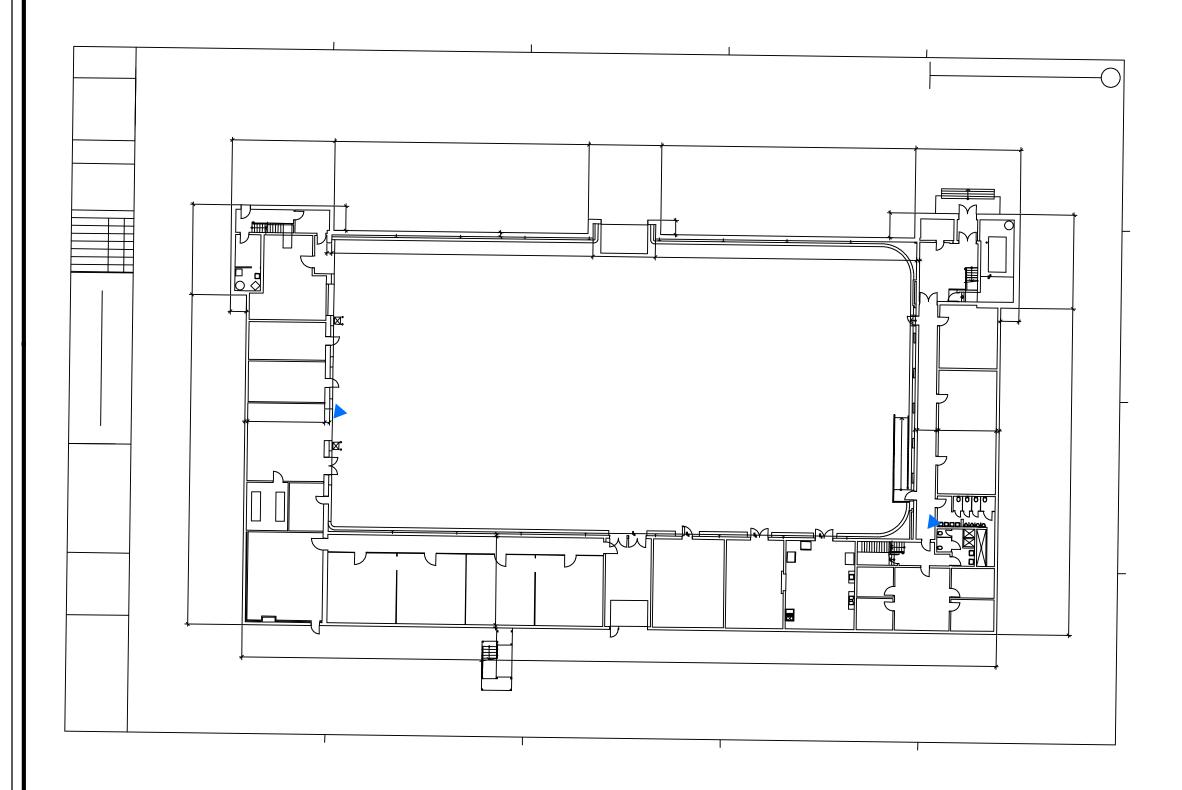

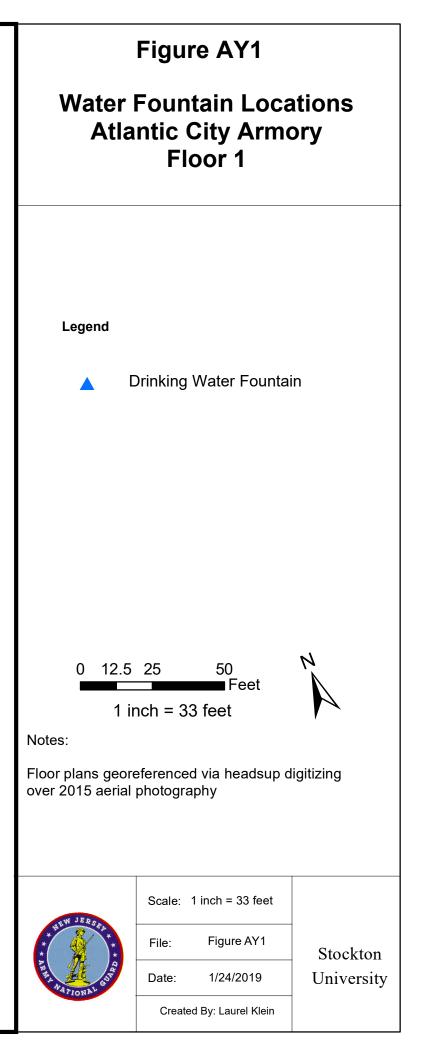



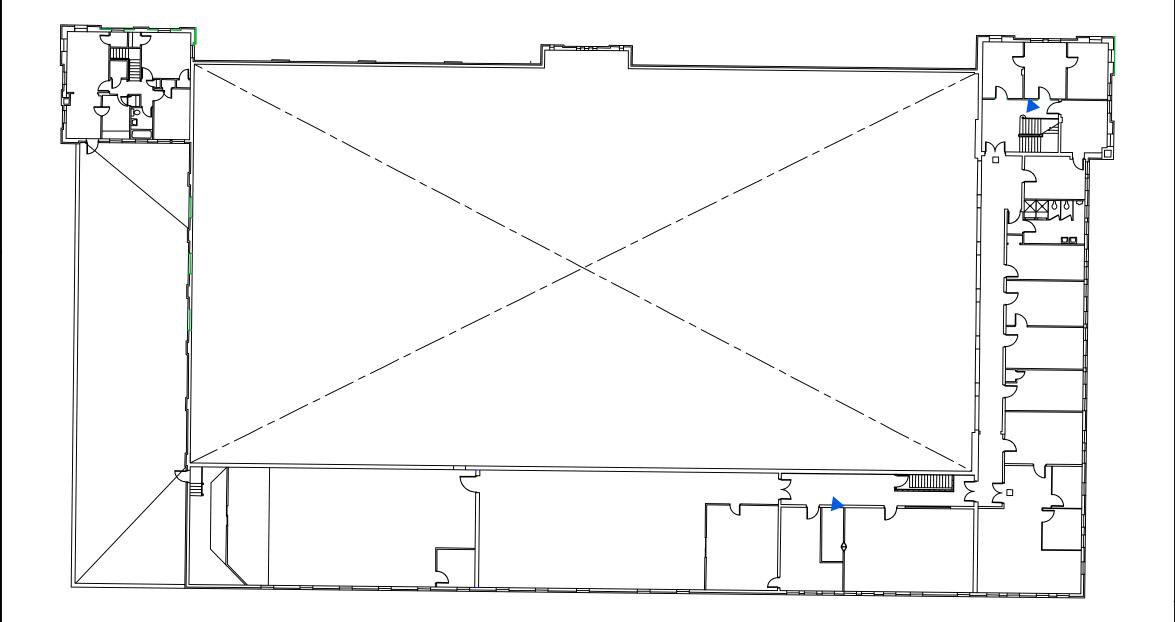

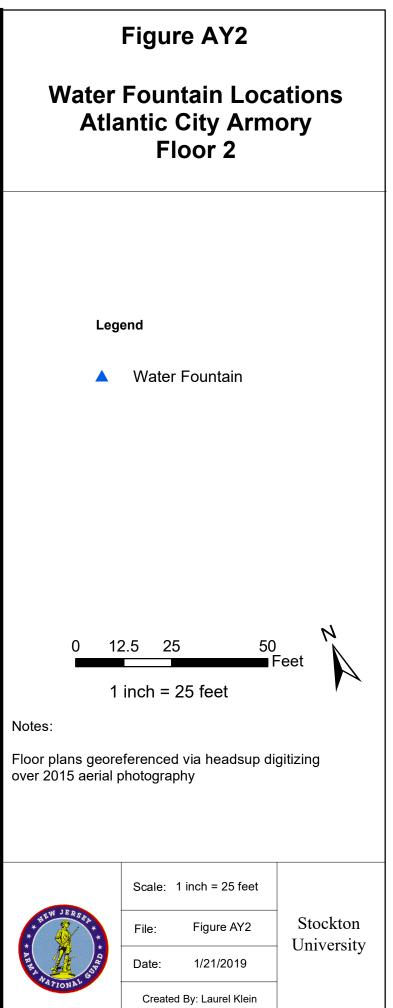



Water Fountain Inventory						
Date:	1/15/2019					
Done By:	Laurel Klein					
Armory Name:	Bordentown					
Armorer:	Sam DelPidio					

Site	Location	Floor	Room	Equipment Name	Make	Model	Serial Number	Refrigerant	GWP	Amount of Refrigerant (lbs/oz)
Bordentown	ARMORY	1	122	Water Fountain	Elkay	EDFP217C B	110227236	N/A	N/A	N/A
Bordentown	OMS	1	OMS-102	Water Fountain	Elkay	EDFP217C B	140823152	N/A	N/A	N/A

Color Co	ode Index	Bordentown OMS site map is unavailible.	-
	Totals		
Class 1	N/A		
Class 2	N/A		
Missing Code	N/A		
GWP Lev	vel* Index		
High	Greater than 2500		
Medium	150-2500		
Low	Less than 150		
Report, 2007. Global Warm 100 y	nd IPCC 4th Assessment Ing Potential (GWP) based year.	Borden town A-22-2013 Burleting B Burleting B Burleti	

Bordentown OMS Water Fountain

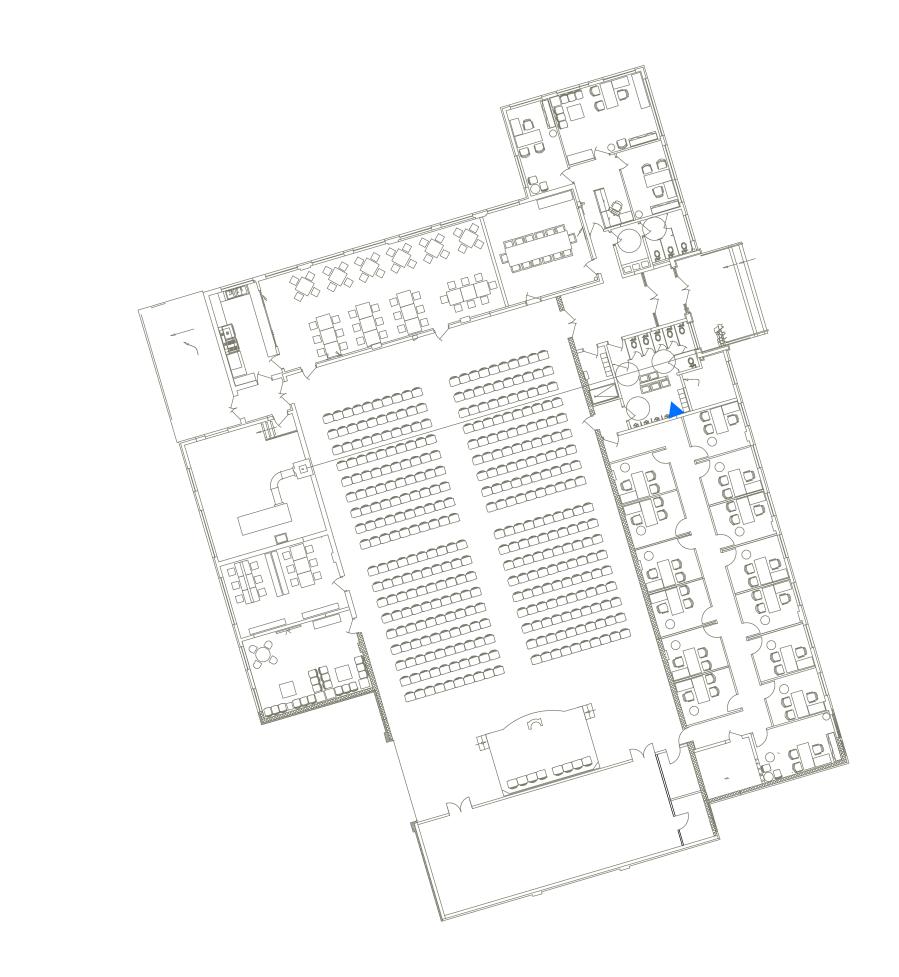

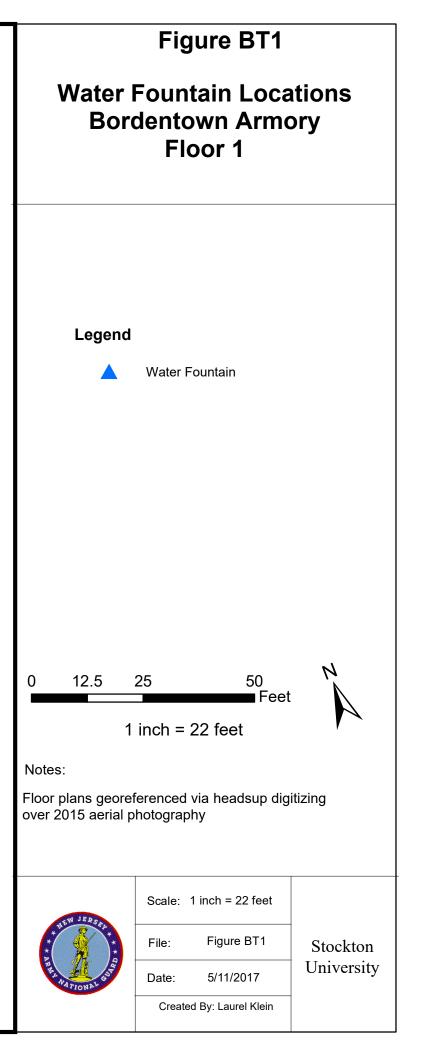

Water Fountain Inventory						
Date:	1/15/2019					
Done By:	Laurel Klein					
Armory Name:	Bridgeton					
Armorer:	Phil Fiore					

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Bridgeton	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A


Color Code Index					
	Totals				
Class 1	N/A				
Class 2	N/A				
Missing Code	N/A				
GWP Le	vel* Index				
High	Greater than 2500				
Medium	150-2500				
Low	Less than 150				
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.					


Water Fountain Inventory						
Date:	1/15/2019					
Done By:	Laurel Klein					
Armory Name:	Cape May					
Armorer:	Steve Allay					


Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
	FMS	1	100	WATER FOUNTAIN	Sunroc	CSW-4	L24412M	R12	High	4.5 oz
Cape May	ARMORY	1	100B	DRINKING WATER FOUNTAIN	Halsey Taylor	\$500_5EQ_1M	70732866	R134A	Medium	3.60 OZ

Color Code Index						
Totals						
1						
0						
0						
vel* Index						
Greater than						
2500						
150-2500						
Less than 150						
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.						



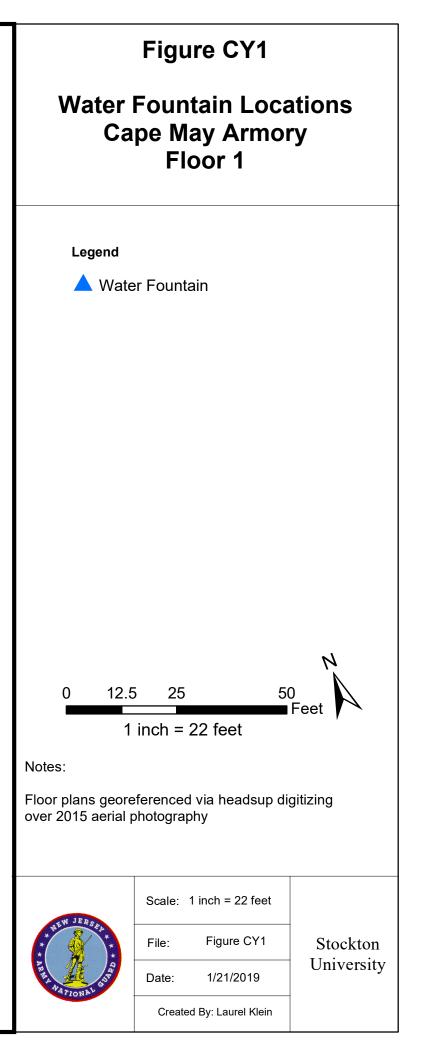

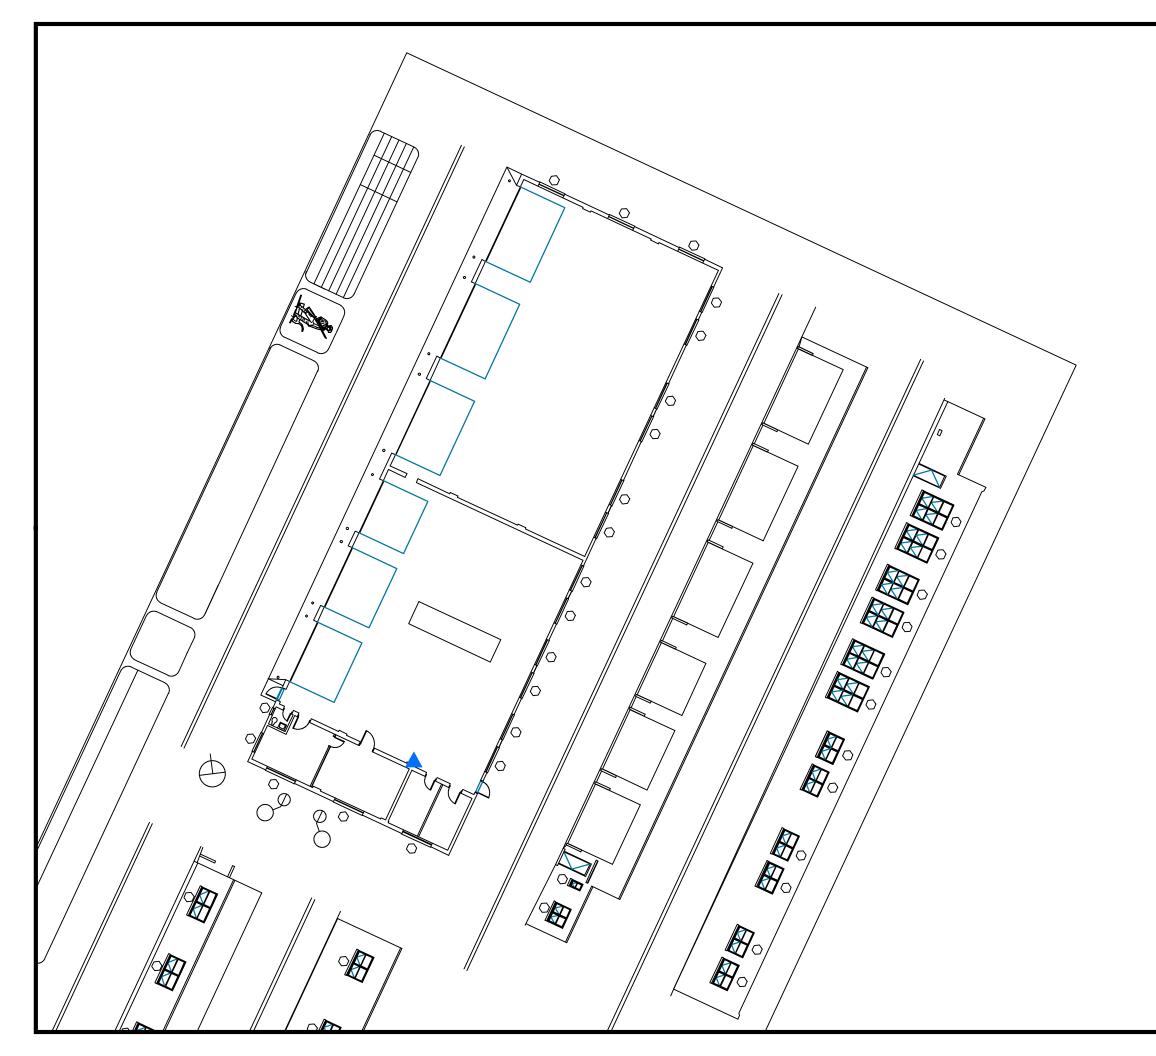

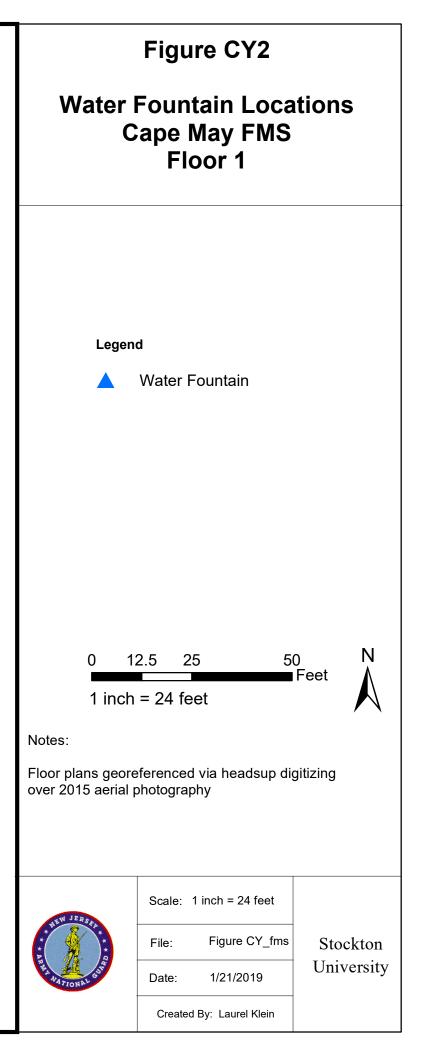


Water Fountain Inventory		
Date:	1/15/2019	
Done By:	Laurel Klein	
Armory Name:	Cherry Hill	
Armorer:	Ed Torres	

	Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
ſ	Cherry Hill	ARMORY	1	120D	WATER FOUNTAIN	Halsey Taylor	HTV8Q1A	60816144	R134A	Medium	3.8 oz
L	Clienty Hill	ARMORY	1	120D	WATER FOUNTAIN	Halsey Taylor	HTV8Q1A	60816144	R134A	Medium	3.8 oz

Color Co	Color Code Index					
	Totals					
Class 1	0					
Class 2	0					
Missing Code	0					
GWP Let	vel* Index					
	Greater than					
High	2500					
Medium	150-2500					
Low	Less than 150					
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.						




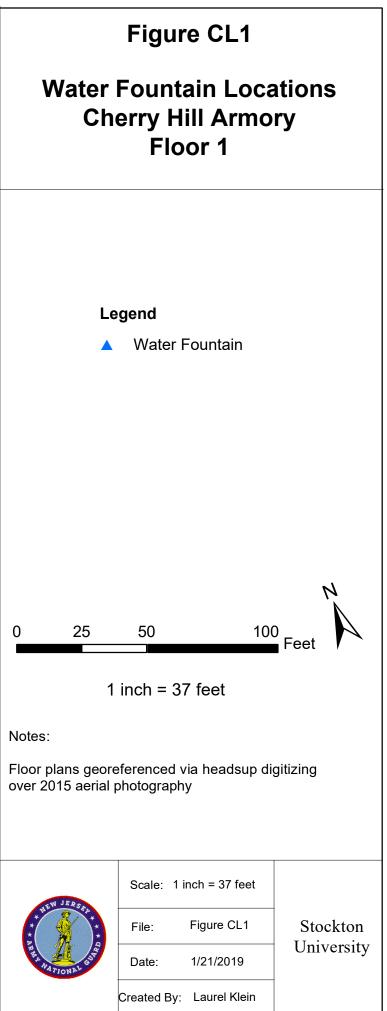


Water Fountain Inventory				
Date:	1/15/2019			
Done By:	Laurel Klein			
Armory Name:	Dover			
Armorer:	Charles Rissmiller			

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Dover	ARMORY	2	200	Water Fountain	Elkay	EBFSA8-1A	960130834	R134A	Medium	4.8 oz

Color Co	ode Index			
	Totals			
Class 1	0			
Class 2	0			
Missing Code	0			
GWP Level* Index				
High	Greater than 2500			
Medium	150-2500			
Low	Less than 150			
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.				

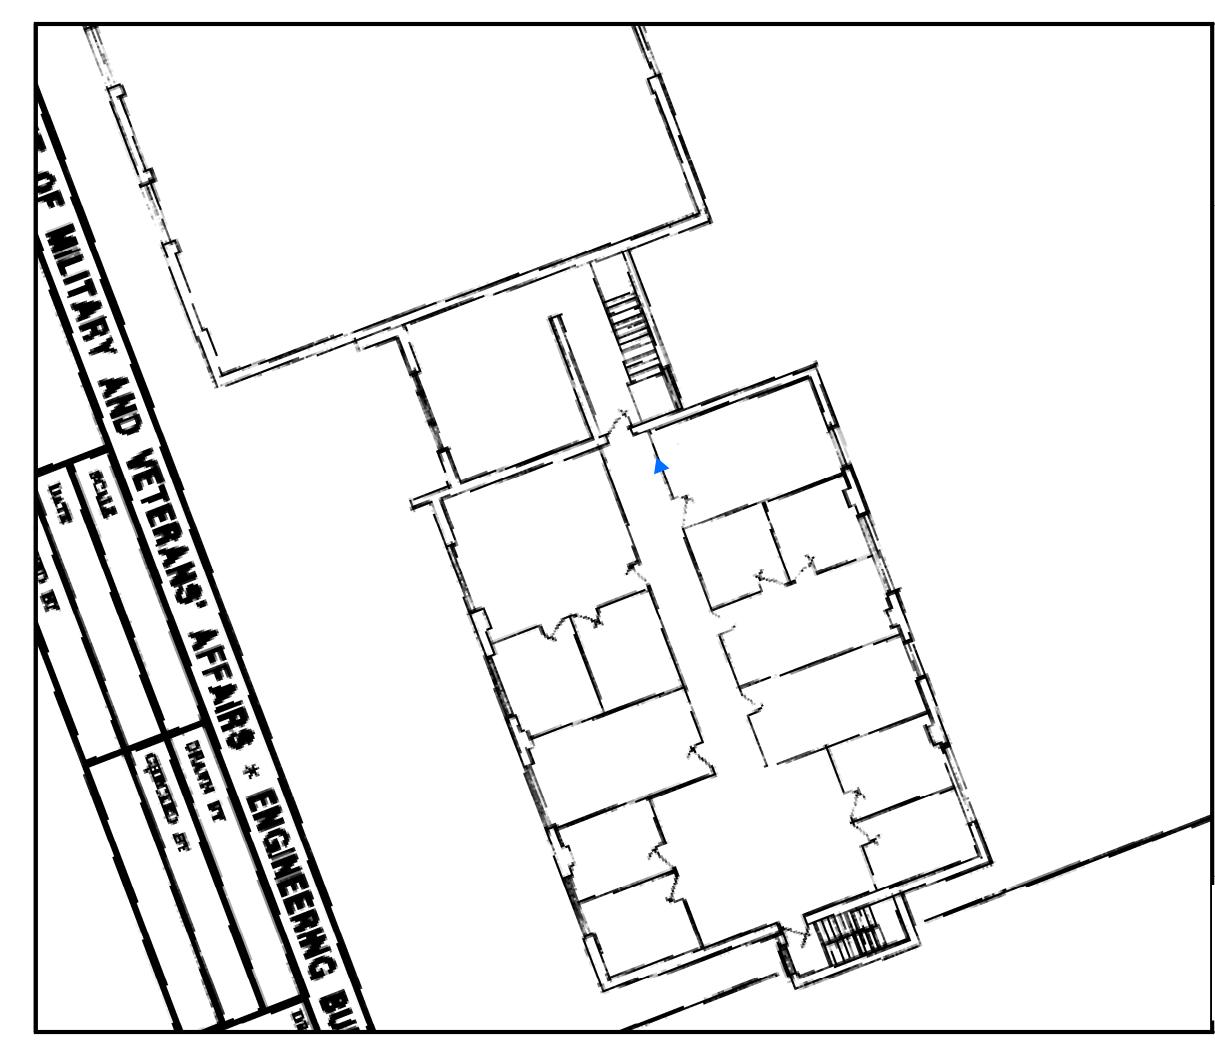

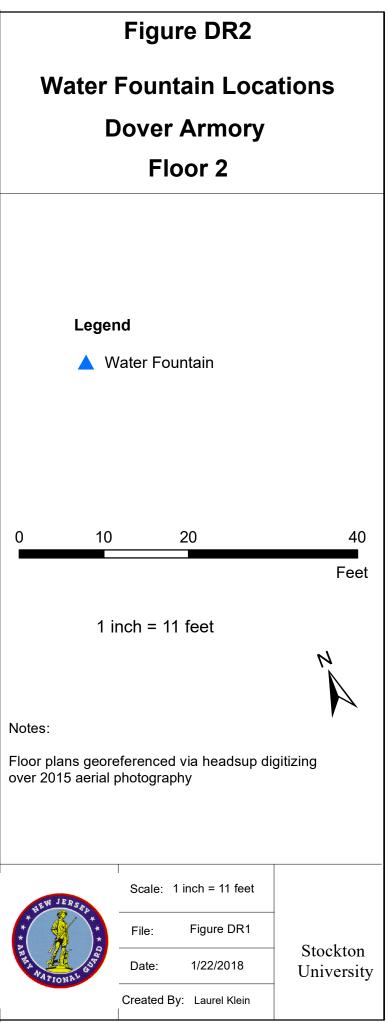

Water Fountain InventoryDate:1/15/2019Done By:Laurel KleinArmory Name:Fort DixArmorer:Scott Reddler

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
	Building 3601	1	Hallway	Water Cooler	AccuPure	F528HB010- EWPN (VWES215)	IE08L02000	R134A	Medium	1.45 oz
	Building 3601	1	Hallway	Water Cooler	AccuPure	F528HB010- EWPN (VWES215)	IE08L01982	R134A	Medium	1.45 oz
	Building 3601	1	Hallway	Water Cooler	AccuPure	F528HB010- EWPN (VWES215)	IE08L02008	R134A	Medium	1.45 oz
	Building 3601	1	Boiler room 2	Water Cooler		F323HB040- WBN-RW210	IA05J09771	R134A	Medium	37 g
	Building 3601	1	Boiler room 3	Water Cooler	Sparklett s	CRB1 ALMOND	96475410	R134A	Medium	1.5 oz
Fort Dix	Building 3601	1	Boiler room 4	Water Cooler	Sunroc	TPV1-001	98080826	R134A	Medium	1.25 oz
	Building 3601	1	Boiler room 5	Water Cooler	Sparklett s	BLF1A-D100	9430 418868	R134A	Medium	1.4 oz
	Building 3601	1	Boiler room 6	Water Cooler	Sparklett s	BLF1A-P	9216 102728	R12	High	1 oz
	Building 3650	1	B104	Water Cooler	Oasis	BPD1SHS-H203	1609601211	R134A	Medium	1.3 oz
	Building 3650	1	C100	Water Cooler	AccuPure	FM1500 DWS	612195- 141061	R134A	Medium	41 g
	Building 3650	1	Hallway	Water Cooler	AccuPure	F528HB010- EWPN	IE08L01983	R134A	Medium	41 g
	Building 3651	1	103	Water Cooler	AccuPure	F528HB011- EWPN	IE11J00263	R134A	Medium	41 g

Color Code Index					
	Totals				
Class 1	1				
Class 2	0				
Missing Code	0				
GWP Level* Index					
High	Greater than 2500				
High Medium					
Ŭ	2500				

Fort Dix site map for building 3601 is unavailable.

Water Fountain Inventory		
Date:	1/15/2019	
Done By:	Laurel Klein	
Armory Name:	Flemington	
Armorer:	Brett Davala	

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Flemington	ARMORY	1	108	Water Cooler	Unknown	F528HB011-NE (VW210EZ)	IE08C04682	R134A	Medium	37g

Color Code Index						
	Totals					
Class 1	0					
Class 2	0					
Missing Code	0					
GWP Let	GWP Level* Index					
High	Greater than 2500					
Medium	150-2500					
Low	Less than 150					
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.						


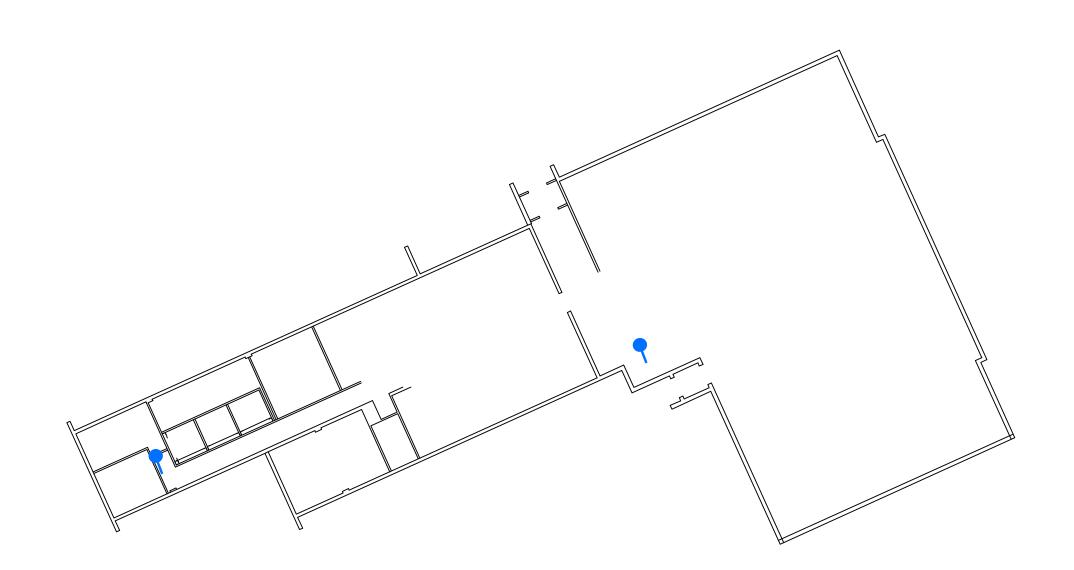


Figure FL Water Fountain Locations Flemington Armory Floor 1

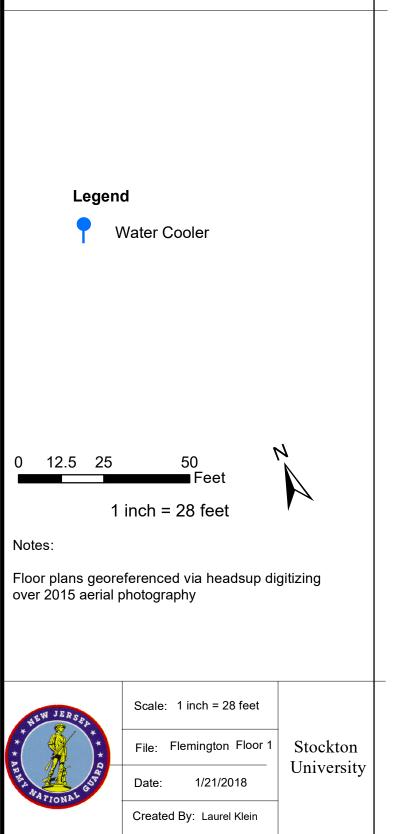

Water Fountain Inventory				
Date:	1/15/2019			
Done By:	Laurel Klein			
Armory Name:	Franklin			
Armorer:	Charles Rissmiller			

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Franklin	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Color Co	de Index						
	Totals						
Class 1	0						
Class 2	0						
Missing Code	0						
GWP Level* Index							
High	Greater than 2500						
Medium	150-2500						
Low Less than 150							
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.							

Water Fountain Inventory					
Date:	1/15/2019				
Done By:	Laurel Klein				
Armory Name:	Freehold				
Armorer:	William Homeyer				

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Freehold	ARMORY	1	100	WATER FOUNTAIN	Oasis	CP3M-D	8822 291269	R12	High	3.8 oz
Freehold	ARMORY	1	100H	WATER FOUNTAIN	Halsey Taylor	SW4AQ_1M	81015181	R134A	Medium	3.7 oz



Freehold Armory Oasis Water Fountain


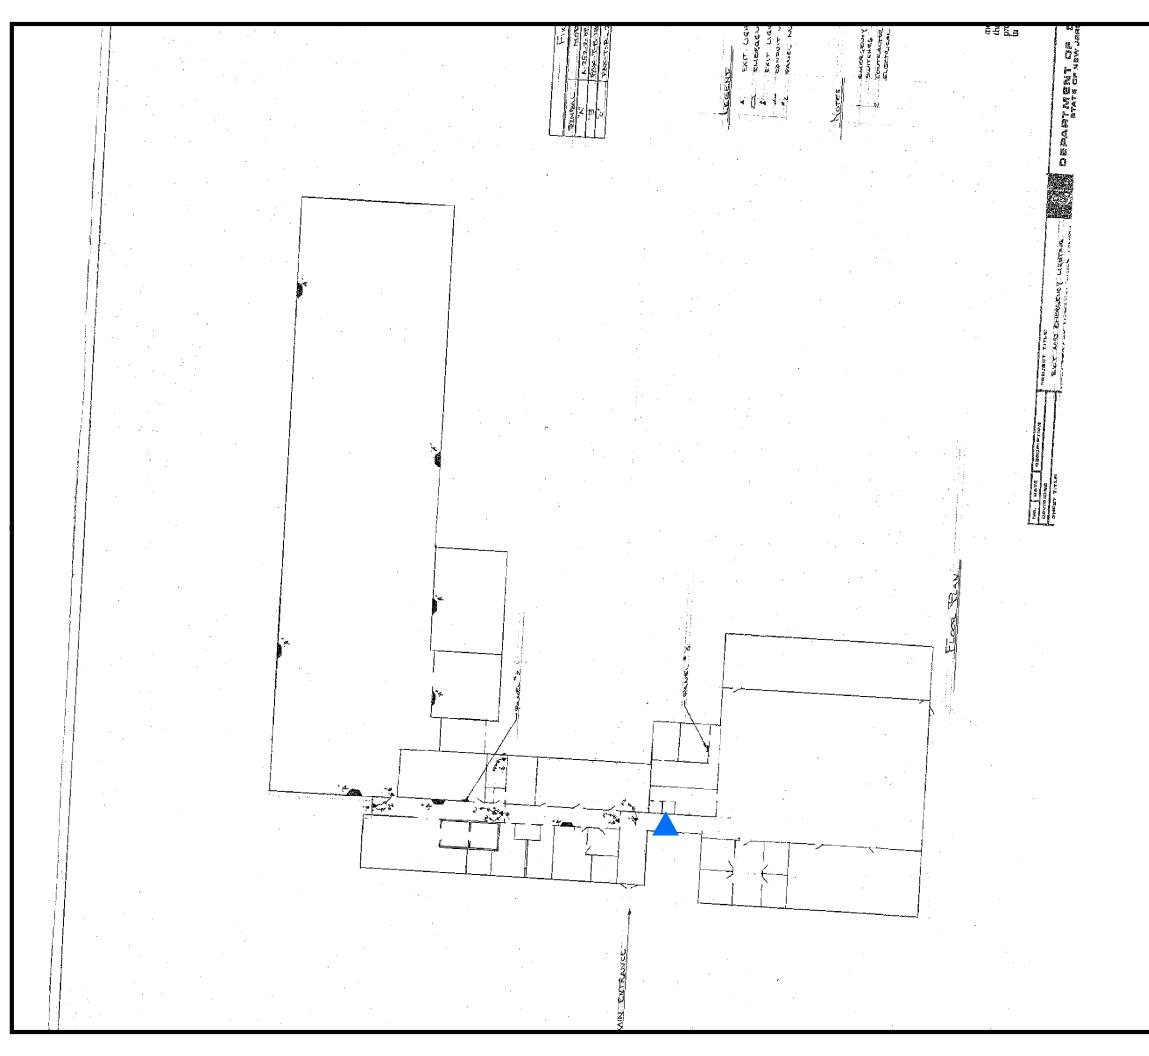


Figure FD1 Water Fountain Locations Freehold Armory Floor 1










Notes:

Floor plans georeferenced via headsup digitizing over 2015 aerial photography


HEW JERSEL	Scale:	1 inch = 42 feet	
	File:	Figure FD1	Stockton
P. HAL WATIONAL GY	Date:	1/21/2019	University
	Create	d By: Laurel Klein	

Water Fountain Inventory					
Date:	1/15/2019				
Done By:	Laurel Klein				
Armory Name:	Hammonton				
Armorer:	Phillip Fiore				

Site	e	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Hammo	onton	ARMORY	1	100H	WATER FOUNTAIN	Halsey Taylor	HTV8Q_1	30716707	R134A	Medium	4.5oz

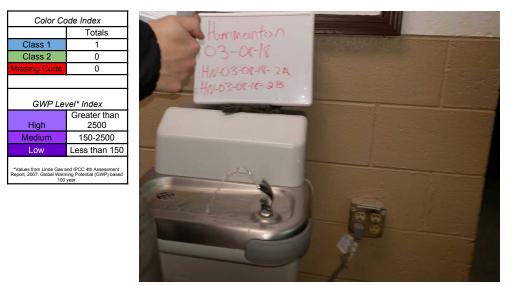

Hammonton Armory Water Fountain

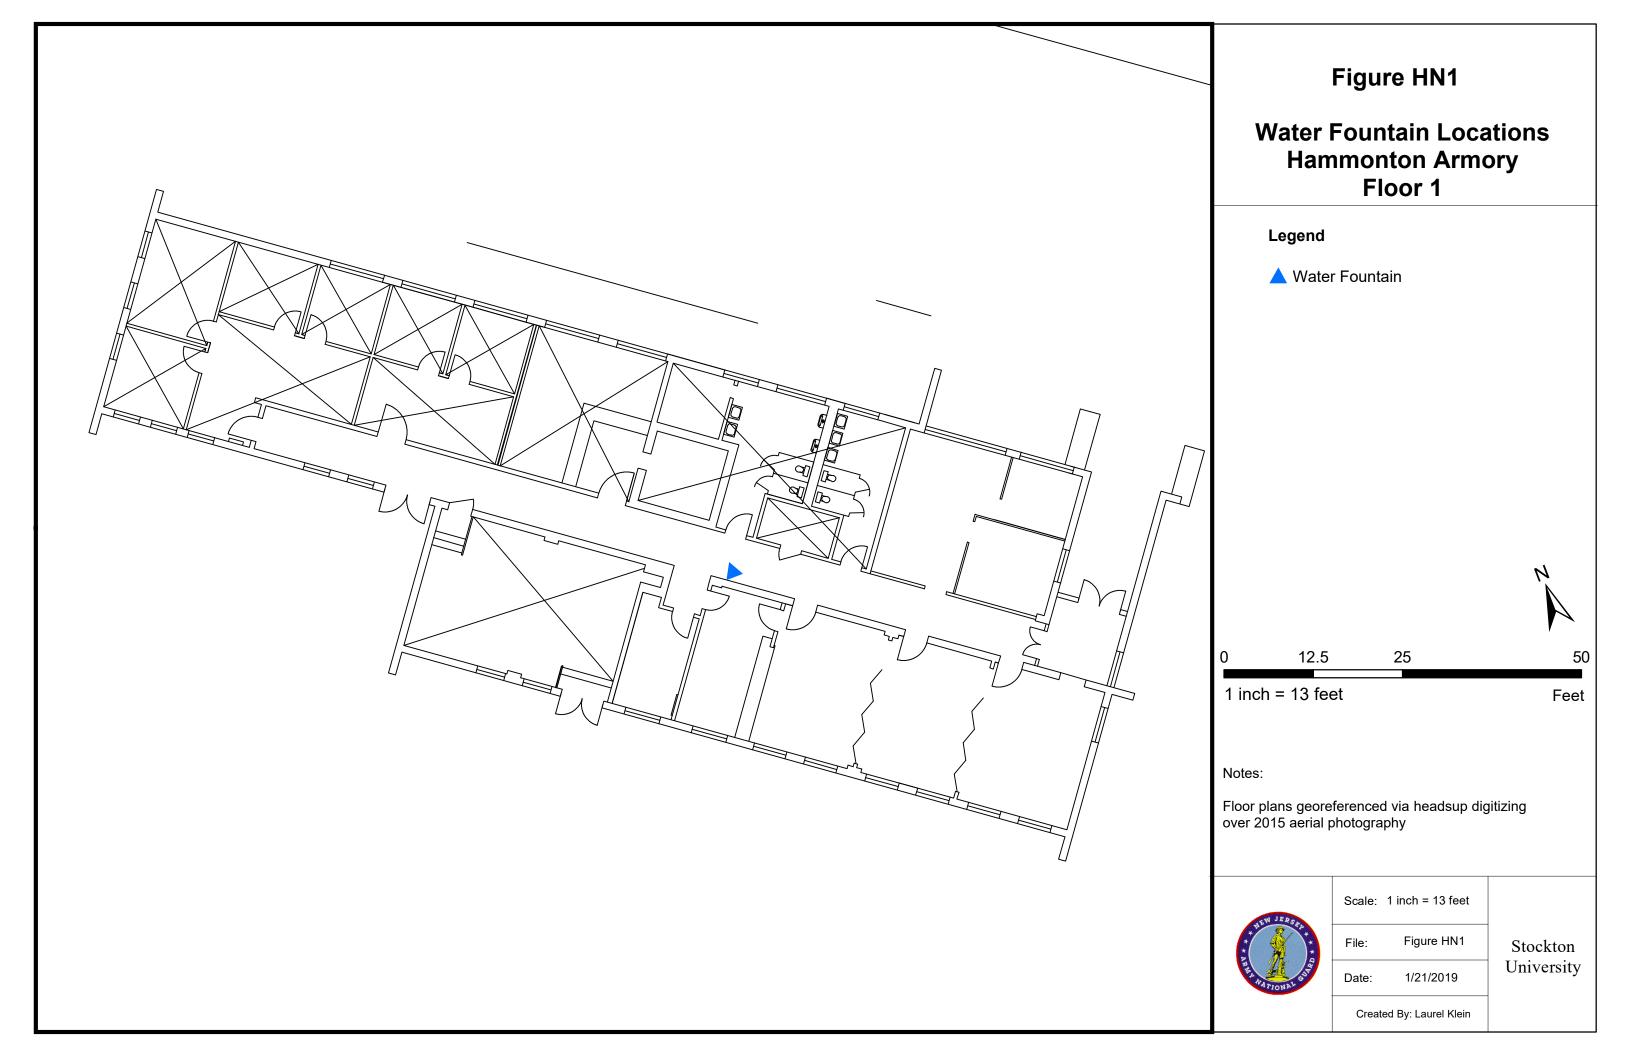

Water Fountain Inventory					
Date:	1/15/2019				
Done By:	Laurel Klein				
Armory Name:	Hackettstown				
Armorer:	Charles Rissmiller				

Site	Location	Floor	Room	Equipment Description	Make	Model	Serial Number	Refrigerant	GWP Level	Amount of Refrigerant (lbs/oz)
Hackettstown	ARMORY	1	100	Water Fountain	Haw's Drinking Faucet Co.	HCBF-7	16347414000000	R12	High	7.25 oz
	ARMORY	1	107	Water Fountain	Sunroc	NSW8	RR31256A	R12	High	5 oz

Color Code Index						
	Totals					
Class 1	2					
Class 2	0					
Missing Code	0					
GWP Level* Index						
High	Greater than 2500					
Medium	150-2500					
Low Less than 150						
*Values from Linde Gas and IPCC 4th Assessment Report, 2007. Global Warming Potential (GWP) based 100 year.						



Hackettstown Armory Haw's Water Fountain

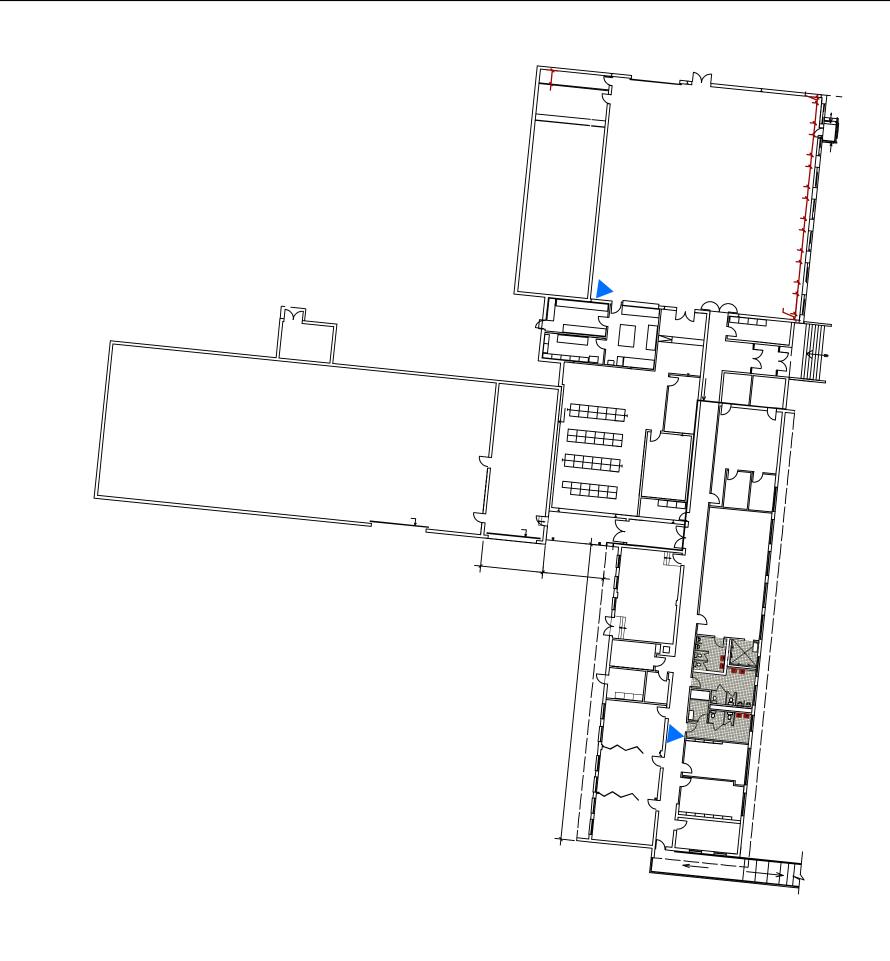


Figure HA1

Water Fountain Locations Hackettstown Armory

